U. S. DEPARTMENT OF AGRICULTURE
RURAL ELECTRIFICATION ADMINISTRATION
TECHNICAL STANDARDS DIVISION

TRANSFORMER PROBLEMS
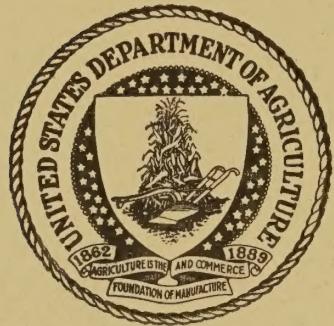
April 15, 1948

FOREWORD

This bulletin is intended to present in condensed form
the solution of many problems occurring in transformer
operation on rural distribution systems. It is a
revision of Technical Standards Bulletin No. 10, dated
March 1, 1944.

TRANSFORMER PROBLEMS

CONTENTS

TRANSFORMER PROBLEMS

I. POLARITY

The polarity of a single phase transformer is determined by the
relative directions of the primary and secondary windings to
the core. In complicated core and winding designs it is some-
times difficult to determine the polarity of the transformer
directly from the direction of the windings. It therefore be-
comes necessary to set up a conventional system for the speci-
fication of polarity based on the arrangement of high and low
voltage terminals on the transformer tank and on the direction
of the induced voltages in the primary and secondary windings.
It is important to remember that the relative directions of the
induced voltage on both primary and secondary must be considered
and not the direction of the impressed primary voltage.

Since the relative directions of the induced voltages as they
appear at the transformer terminals depend on the order in which
these terminals are considered, it becomes necessary to adopt some
convention with respect to the order of consideration of the
terminals. It is commonly accepted that the terminals of the
high and low voltage windings are considered in the order in which
they are brought out of the tank when the observer faces the tank
from any one direction. To make this clear, refer to Figures 1a
and 1b.
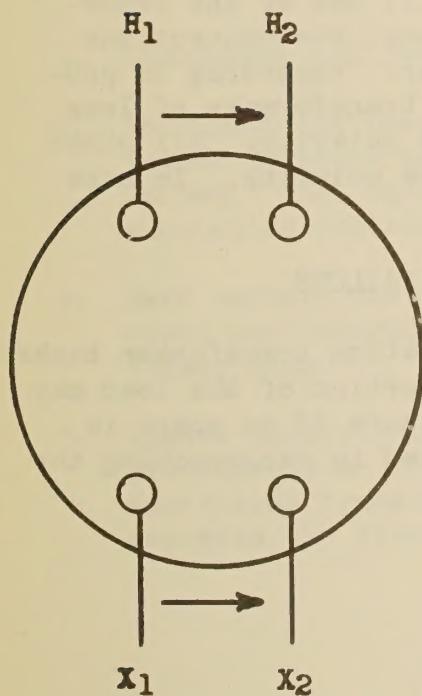
Fig. 1a
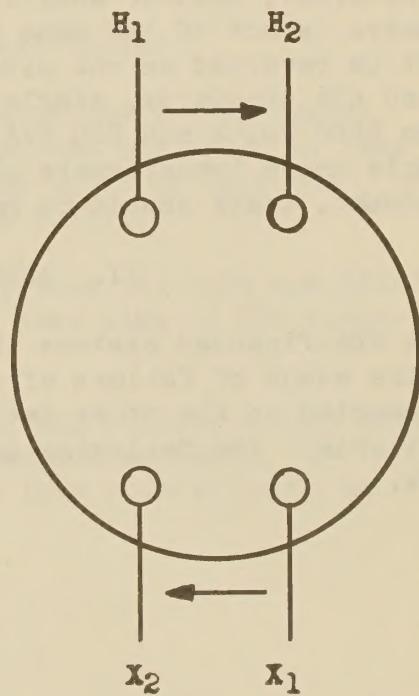
Fig. 1b

In these figures H_1 and H_2 represent the high voltage terminals, X_1 and X_2 the low voltage terminals. The arrows represent the directions of the induced voltages. Thus in Figure 1a, looking at the transformer tank from the low voltage side we see that the induced voltages are in the same directions in both windings. The polarity in this case is called "subtractive." The terminals are also numbered in this order, i.e., X_1 opposite H_1 and X_2 opposite H_2.

In Figure 1b, the directions of the induced voltages are opposite and the terminals are numbered accordingly so that X_2 is opposite H_1 and X_1 opposite H_2. The polarity here is called "additive."

The reason for the terms "additive" and "subtractive" polarity become evident when the method of testing the polarity of a transformer is considered. Referring to Fig. 1b, if any two adjacent high and low-voltage terminals are connected together, such as, for example, H_1 and X_2 and voltage applied across either the primary or secondary windings, then the voltage measured between the free high and low voltage windings, H_2 and X_1 is the sum of the primary and secondary voltages. In the case of Figure 1a, if say, terminals H_1 and X_1 were connected and one winding excited the voltage across H_2 and X_2 would be the difference between the primary and secondary voltages. In making these tests only a small fraction of the rated voltage need be used for exciting the transformer.

When connecting transformers in parallel, or using special connections, great care must be taken in observing proper polarity. In the following connection diagrams, the same polarity is assumed for each transformer, whether additive or subtractive. If one of the transformers is not of the same polarity as the others, the connections must be reversed on one side of this transformer. According to proposed ASA standards, single phase distribution transformers of less than 8660 volts and 200 KVA shall have additive polarity. All other single phase transformers shall have subtractive polarity. In case of doubt, tests should be made.

II. SUBSTATION TRANSFORMER FAILURE

Most REA-financed systems have delta-wye substation transformer banks. In the event of failure of one transformer, a portion of the load may be carried on the other two as an emergency measure if no spare is available. The following procedure is to be used in reconnecting the bank.

A. Substation Reconnections for a Delta-Wye Bank:
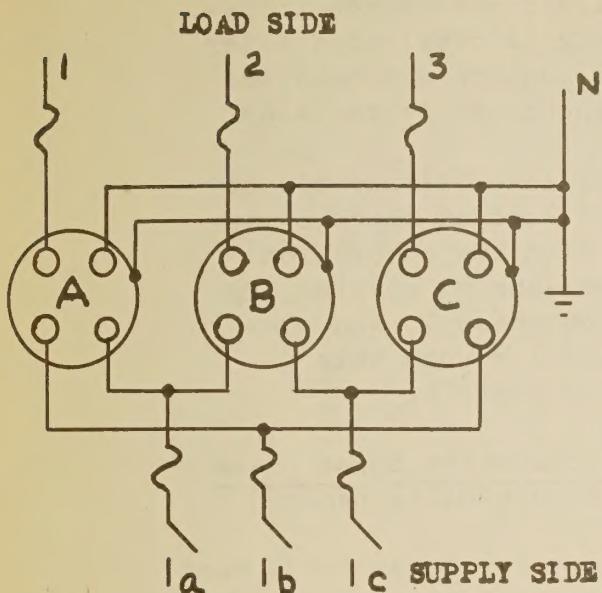
LOAD SIDE   LOAD SIDE

Figure 2.   Before Failure   Figure 3.   After Failure
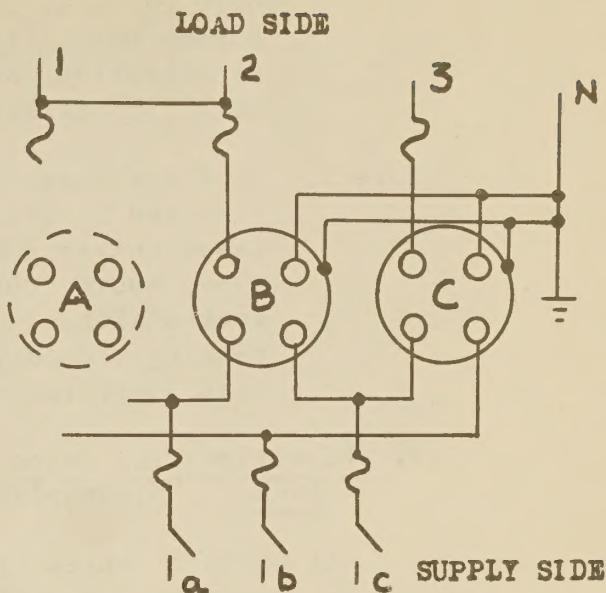
Directions: (It is assumed that all 3 phase loads served by the line
              have been disconnected.)

1. Open all disconnects or cut-outs on the supply and load sides
   of substation transformer bank, and ground the lines on the
   load side.

2. Disconnect all leads to transformer that failed.

3. Reconnect the phase wire on the Y side of the faulty trans-
   former to phase two or three, selecting the one which is less
   loaded. This connection should be made so as to have the
   substation protected by the cut-out as before.

4. Make certain that no connections other than the ones specified
   above are changed on either supply or load side of the trans-
   former bank.

5. Remove safety ground on the load side, and reclose supply side
   disconnects or cut-outs on the two good transformers, re-
   energizing transformer bank. Reclose load side cut-outs to
   energize the lines.

- 3 -

Note 1: The two-transformer bank can carry but 86.6% of the rated capacity of the two transformers. This means that the two transformers can carry only 57.8% of load of the former three-transformer bank. If the bank is overloaded after reconnection, some load must be disconnected until the defective transformer is replaced.

Note 2. On three phase lines the load balance can be improved by dividing the load on phase 1 between phases 2 and 3. With the connection shown above, this can be done by opening any sectionalizing cut-out on phase 1, and connecting the part of phase 1 beyond this sectionalizing cut-out to phase 3.

B. Directions for reconnecting consumer's three phase bank: (This applies only to Wye-Delta banks.)

All banks of three transformers for power loads must be reconnected on primary side in the event of failure of one transformer.
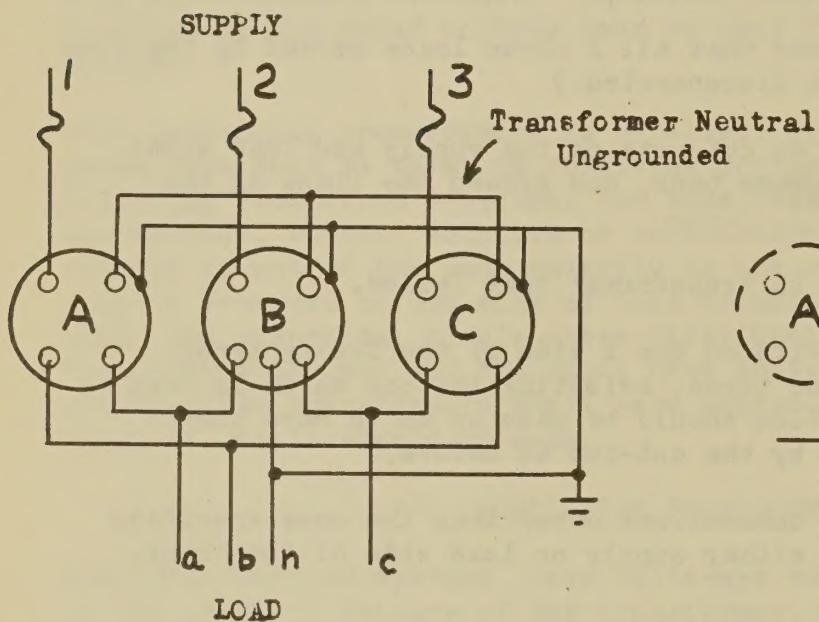
Figure 4
Three Phase Bank
Before failure of
Substation Transformer
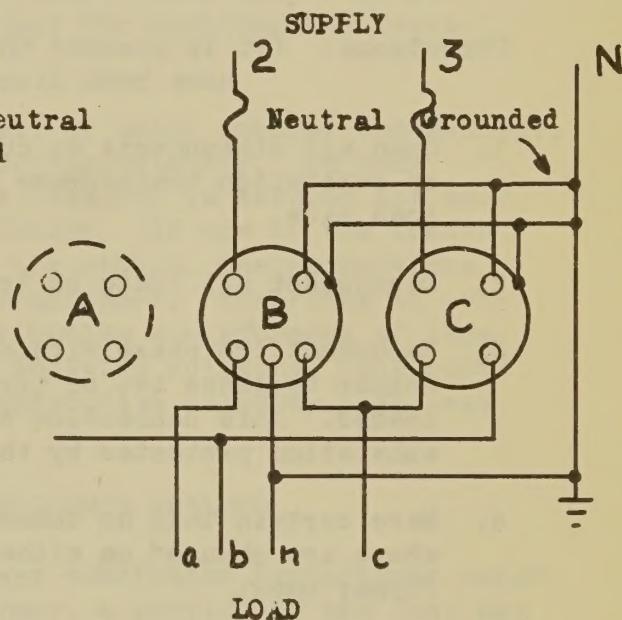
Figure 5
Three Phase Bank
After failure of
Substation Transformer

1. Open cut-outs on all three phases on the primary side
2. Disconnect, and remove from service, transformer A of the three transformers. The final connections are shown in Fig. 5. Phase 2 must not be connected to phase 3 at any point between the bank and the substation. Connect transformer neutral bus to ground.
3. Make certain that no other changes have been made to load side connections of transformers.
4. See Note 1, Fig. 6, Page 9
5. Reclose cut-outs on the two transformers that are to remain in service.
6. Check voltage and phase rotation before leaving consumer's premises. Phase rotation may be checked by observing direction of rotation of unloaded polyphase motors.
7. If consumer has a V-bank (see Fig. 6), make certain that the two phase wires are not connected in parallel at any point.

III. PARALLELING TRANSFORMERS

For exact division of load in proportion to ratings, for transformers in parallel, the voltage ratings must be identical, the percentage impedances equal, and the ratio of resistance to reactance the same for both. Any other conditions involve division of load not in proportion to ratings, and may also cause circulating current to flow. Transformers may be operated in parallel when some of these conditions are not met, but with resultant loss in efficiency. One manufacturer makes the following recommendations:

"It is not considered good practice to operate transformers in parallel under the following conditions:

1. When the division of load is such that the load current flowing in any one is greater than 110% of its normal full load value, with a total load equal to the combined KVA rating.
2. When the no-load circulating current of any transformer exceeds 10% of the full load rated value.
3. When the arithmetical sum of the circulating and load currents is greater than 110% of the normal full load current.

"In the above, circulating current means the current flowing at no load exclusive of exciting current. By load current is meant the currents flowing under load, exclusive of exciting and circulating currents."

A. Unequal Voltage Ratio

The most important requirement is to have equal voltage rat-
ings on each side for the transformers to be paralleled. If
the voltage ratios are unequal, a circulating current results.
For equal or nearly equal percent impedances and unequal
ratios the following formula may be used to calculate the
circulating current. It is exact where the ratios of resis-
tance to reactance in the two transformers are equal, but
also sufficiently accurate for most other cases.

$$\%I_{cl} = \frac{\%e \ (100)}{\%Z_1 + K\%Z_2} \qquad (1)$$

Where $\%I_{cl}$ = circulating current in percentage of
the rated current of unit No. 1

$\%e$ = difference in voltage ratio expressed
in percentage of normal

$\%Z_1$ = percent impedance of unit No. 1

$\%Z_2$ = percent impedance of unit No. 2

$K = \frac{KVA_1}{KVA_2}$

Example:

Two transformers of 5% impedance are connected in parallel
in a single phase bank on a 7200 volt line, transformer 1
having a voltage ratio of 12,750/7200 and transformer 2 a
ratio of 12750/7620. Capacity of transformer 1 is 100 KVA
and of transformer 2 is 50 KVA.

Then: voltage ratio of transformer $1 = \frac{12750}{7200} = 1.77$
(this is normal ratio)

voltage ratio of transformer $2 = \frac{12750}{7620} = 1.68$

$\%e = \frac{1.77 - 1.68}{1.77} \times 100 = 5.1\%$

$\%Z_1 = \%Z_2 = 5\%$

$K = \frac{Kva_1}{Kva_2} = \frac{100}{50} = 2$

$\%I_{cl} = \frac{5.1 \times 100}{5 + 2 \times 5} = 34\%$

Such a parallel combination would obviously be unsuitable. In
order to obtain the actual circulating current in amperes the
rated current of transformer 1 is multiplied by I_{cl}. In the
above example the rated current would be $I_1 = \frac{100,000}{7200} = 13.9$
amps. and $I_{cl} = 0.34 \times 13.9 = 4.7$ amps.

- 6 -

B. Unequal Percentage Impedances

For equal ratios, and unequal percentage impedances, the load division may be calculated approximately as follows:

Note: This method is exact when ratios between resistance and reactance of both transformers are equal.

$$I_1 = \frac{KVA_1/\%Z_1}{C} \times I_L \qquad (2)$$

$$I_2 = \frac{KVA_2/\%Z_2}{C} \times I_L \qquad (3)$$

$$C = \frac{KVA_1}{\%Z_1} + \frac{KVA_2}{\%Z_2} + \quad \cdots$$

I_L = Total load current

I_1 = Current No. 1

I_2 = Current No. 2

KVA_1 = Capacity of No. 1

KVA_2 = Capacity of No. 2

$\%Z_1$ = Percent impedance of transformer No. 1

$\%Z_2$ = Percent impedance of transformer No. 2

Example:

Assume two transformers with equal voltage ratios connected in parallel. Transformer 1 is of 100 Kva and 5% impedance. Transformer 2 is 50 Kva and 5.5% impedance. Total load current is 15 amperes.

$$Kva_1 = 100$$

$$Kva_2 = 50$$

$$I_L = 15 \text{ amperes}$$

$$\%Z_1 = 5$$

$$\%Z_2 = 5.5$$

$$C = \frac{100}{5} + \frac{50}{5.5} = 29.1$$

$$I_1 = \frac{100/5}{29.1} \times 15 = 10.3 \text{ amperes}$$

$$I_2 = \frac{50/5.5}{29.1} \times 15 = 4.7 \text{ amperes}$$

If the line voltage is 7,200 volts, rated current for transformer 1 $= \dfrac{100,000}{7,200} = 13.9$ amps and for transformer 2 $= \dfrac{50,000}{7,200} = 7$ amps. Both transformers are therefore operating within the limits of rated capacity.

C. Unequal Ratios and Unequal Percent Impedances

Where both the voltage ratios and transformer impedances are different the circulating current due to off-ratio as calculated from A should be added to the load current in each transformer as calculated from B, to obtain the total current flowing in each transformer.

In many cases, resistance or reactance in the connections may unbalance parallel transformers. By properly adding the correct amount to the resistance and reactance in the leads, unbalanced transformers may be perfectly balanced.

In connecting transformers in parallel, it is obviously important that the polarity of the voltages be carefully checked. After ascertaining the polarities of all transformers, a diagram of connections should be drawn before attempting any such work. If the transformers are connected in parallel with the reversed polarities large secondary circulating currents will result which will usually damage the transformers if not interrupted immediately.

IV. THREE PHASE SERVICE

Fig. 6 and Fig. 7 show the recommended connections for three phase service. Fig. 6 commonly called the "open-delta" or "V" connection should not be used in an excessive number of installations as it causes some unbalance on the system. Single bushing transformers may be used for the "V" connection, but if there is any possibility of placing these transformers in a bank of three, double bushing transformers should be obtained so that the connection shown in Fig. 7 can be used at a later date.

In the diagrams, all transformers are considered to be of the same polarity. If one is of unlike polarity, connections to it must be reversed, either on the primary or the secondary.

Where lines are sectionalized by means of single pole breakers, LINE-MEN MUST BE CAREFUL TO THOROUGHLY GROUND AN OPEN LINE BEFORE WORKING ON IT. For example, in Fig. 7, if a breaker opened phase A on the source side of the three phase bank, phases B and C remaining energized, partial voltage might still exist on phase A beyond the breaker, due to voltage and current relations in the three phase bank.

PRIMARY

A

B

N NEUTRAL

HIGH VOLTAGE
BUSHING

Single bushing
transformers
can be used
if desired.

GROUND
STUD

SECONDARY
BUSHING

120/240 Volt service
for lighting.

Conductor "N" to be
omitted if no lighting
is required.

GROUND

240 Volt, 3 Phase

1   N   2   3
SECONDARY
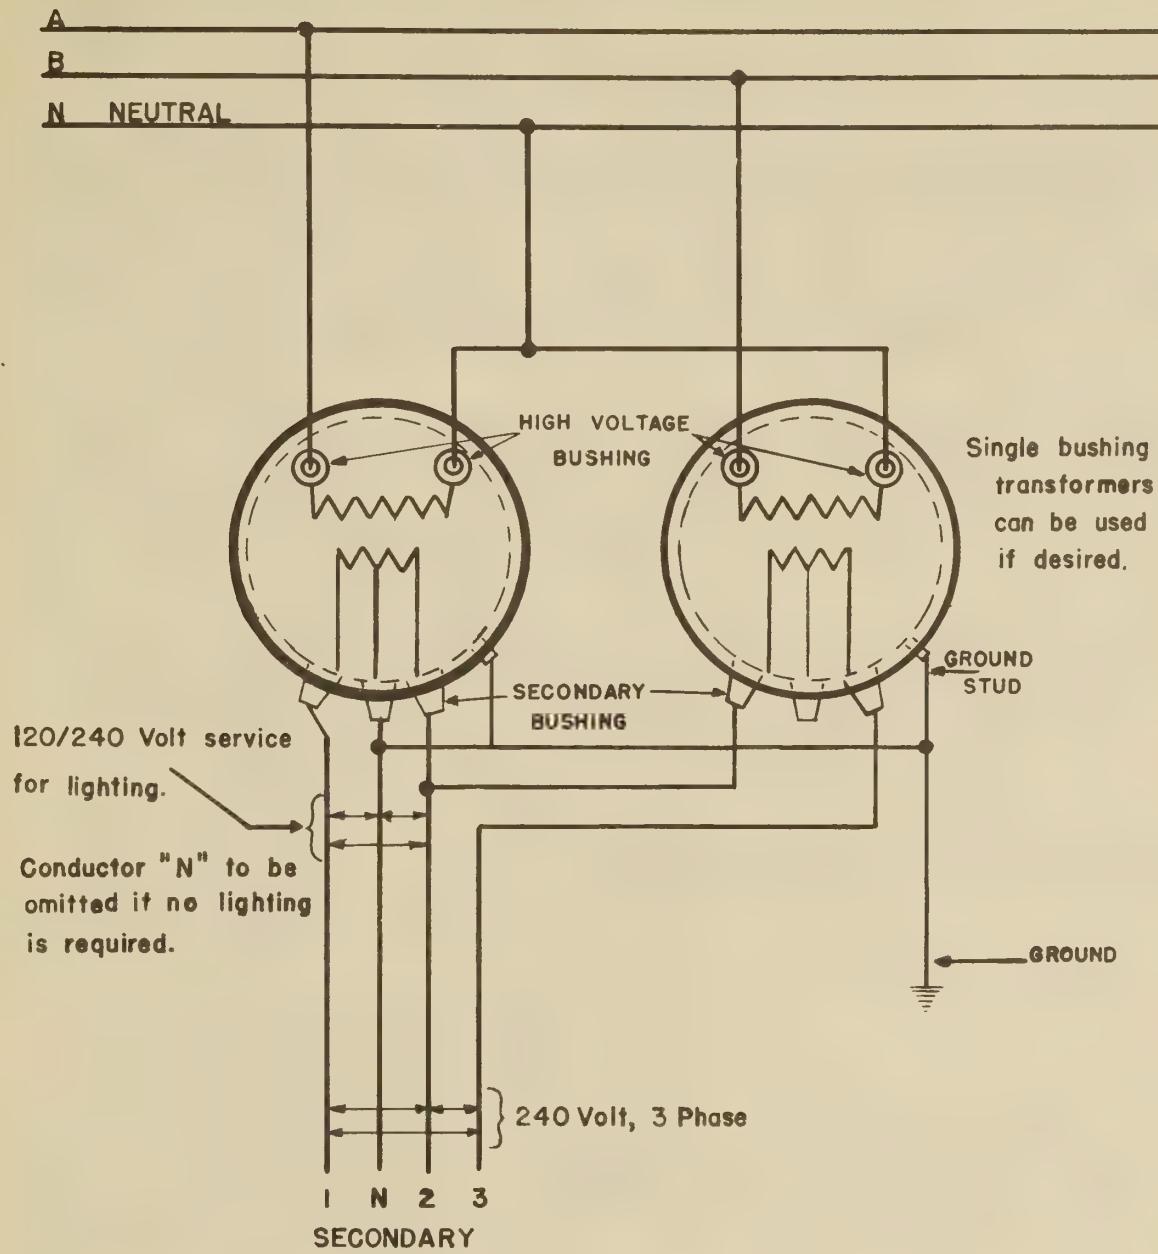
NOTE:

  Combined capacity of two transformer should be 15.5% greater than combined capacity of three transformers △ or Y connected for the same load.

  All internal connections from secondary coils to tanks must be removed.

  A three-phase, four wire, delta meter must be used if conductor "N" is brought in.

	"V" CONNECTION WITH TWO TRANSFORMERS FOR THREE PHASE SERVICE	
Fig. 6	N. T. S.	DATE: 8/20/42
		A-2458

PRIMARY

A

B

C

N NEUTRAL

INSULATED UNGROUNDED NEUTRAL MOUNTED ON INSULATORS

HIGH VOLTAGE
BUSHING

GROUND
STUD

SECONDARY
BUSHING

240/120 Volt single phase three wire
for lighting

Conductor "N" to be omitted if no
lighting is required.

GROUND

(Should be con-
nected to primary neutral
if available on same pole.)

240 Volt, 3 Phase, Delta

1 N 2 3
SECONDARY
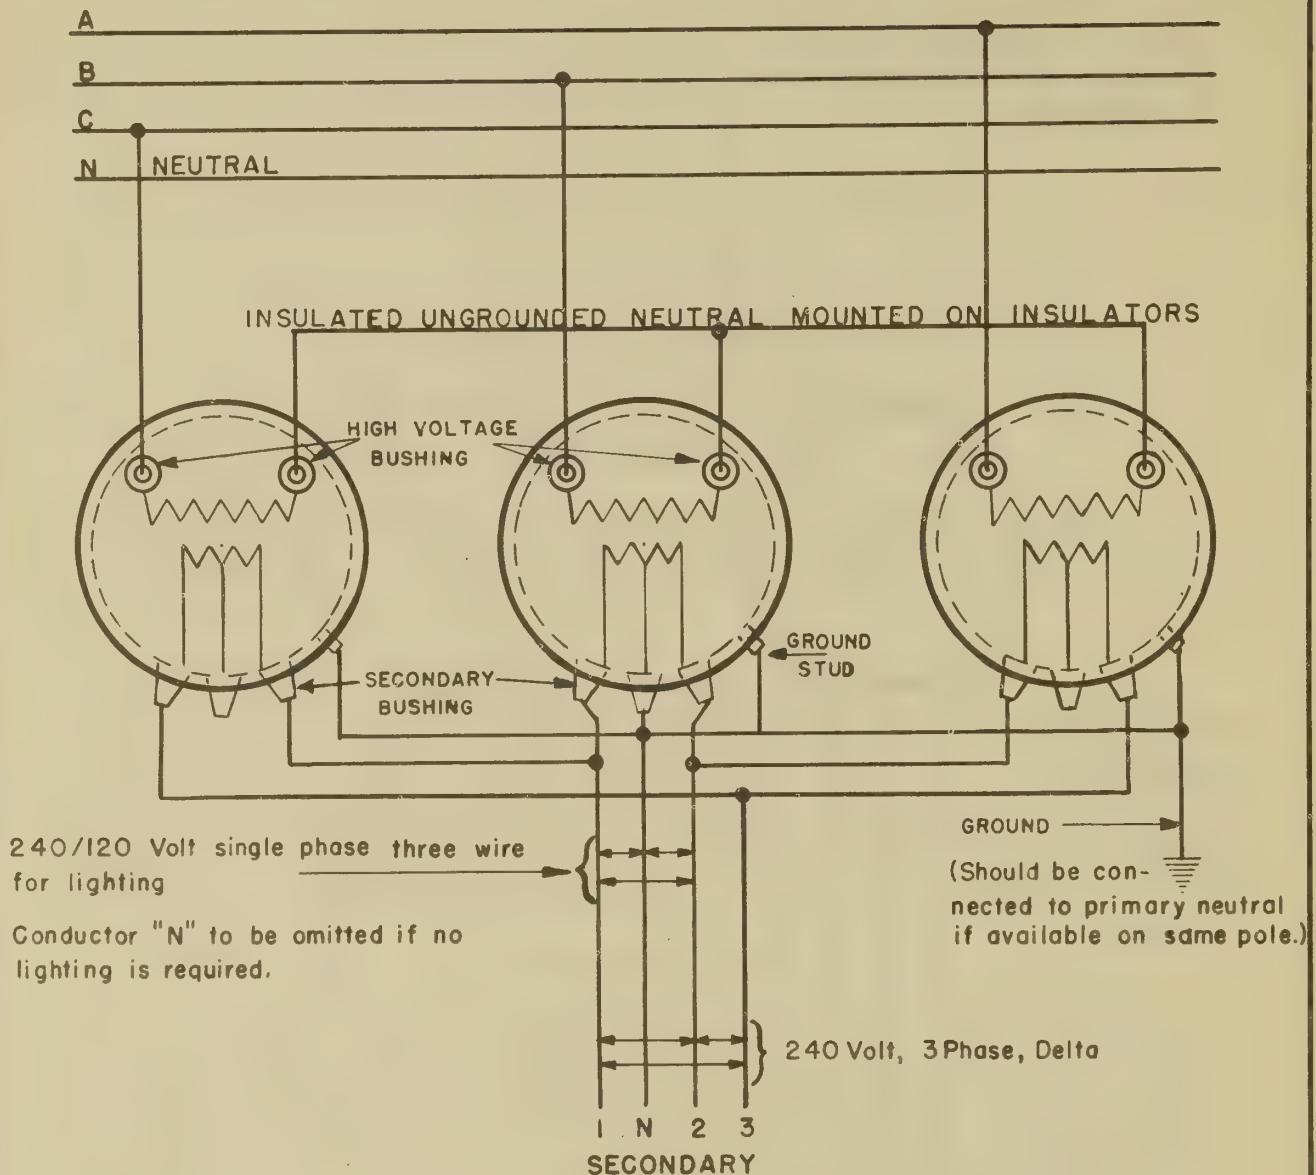
All internal connections from secondary coils to tank must be removed.

A three-phase, four wire, delta meter must be used if conductor "N" is brought in.

Fig. 7

12.5 KV PRIMARY 3 PHASE 4 WIRE Y - △
SCHEMATIC TRANSFORMER WIRING DIAGRAM

N.T.S.		DATE: 8/26/42
		A-2390

The amount of voltage on an open phase is variable, depending on many factors, but it may be as great as one-half the normal line-to-ground voltage. ALWAYS TREAT A LINE AS HOT UNTIL IT IS GROUNDED.

V. SINGLE PHASE LOAD ON THREE PHASE BANK

In many three phase transformer bank installations, it is also desired to serve some single phase load. Figs. 8, 9, and 10, copied by permission from "Transformer Engineering" by L. F. Blume (John Wiley & Sons, Inc.), give the limits of loads which may be served with various transformer combinations. The use of these curves can best be illustrated by examples.

Example 1:

Assume three transformers in a wye-delta bank rated as follows:

Transformer A - 15 KVA
Transformer B - 10 KVA
Transformer C - 10 KVA

The three phase load is 10 KVA at 80% power factor. What single phase load at unity power factor can be placed on transformer A without overloading any unit in the bank?

Solution: Use Fig. 9

The three phase KVA load in percent of transformer B rating in KVA = $\frac{10}{10}$ (100) = 100%.

Ratio of KVA_A to KVA_B = $\frac{15}{10}$ = 1.5

At 100% on the abscissa proceed vertically upward to the curve with R = 1.5. Then proceed horizontally and find that the single phase KVA in percent rating of unit B equals approximately 182%. Hence, additional allowable single phase load on A equals 1.82 (10) = 18.2 KVA.

If the three phase load were 20 KVA, the additional allowable single phase load on A would be found to be about 105% of transformer B rating or 10.5 KVA.

If the single phase load is known, the allowable three phase load may be found by the reverse process.

Example 2:

Given a three phase load of 20 KVA and a single phase load of 10 KVA, what transformer ratings should be used in a wye-delta bank?

380
360
340
320
300
280
260
240
220
200
180
160
140
120
100
80
60
40
20
0

R = 2.0

R = 1.9
R = 1.8
R = 1.7
R = 1.6
R = 1.5
R = 1.4
R = 1.3
R = 1.2
R = 1.1
R = 1.0

THREE-PHASE LOAD
(P-F. = 1.0)

PRIMARY
THREE-
PHASE

SINGLE-PHASE LOAD
(P-F. = 1.0)

LIMIT CURVE

Single - phase kv-a in Per Cent of kv-a Rating of Unit B $= \dfrac{kv\text{-}a_{1\phi}}{kv\text{-}a_b} \times 100$

Three phase kv-a in Per Cent of kv-a Rating of Unit B $= \dfrac{kv\text{-}a_{3\phi}}{kv\text{-}a_b} \times 100$

0 20 40 60 80 100 120 140 160 180 200 220 240 260 280 300 320

Maximum Permissible Load on Isolated Y-Δ Transformer
Bank having Three Single-phase Units A, B, and C.
Three-phase Power Factor of 100 Per Cent.

$Kv\text{-}a_b = Kv\text{-}a_c$

$R = \dfrac{Kv\text{-}a_a}{Kv\text{-}a_b}$

Fig. 8

Maximum Permissible Load on Isolated Y-△ Transformer
Bank having Three Single-phase Units A, B and C.
Three-phase Power Factor of 80 Per Cent.

$$Kv\text{-}a_b = Kv\text{-}a_c$$

$$R = \frac{Kv\text{-}a_a}{Kv\text{-}a_b}$$

Fig. 9

791107 O - 48 - 3
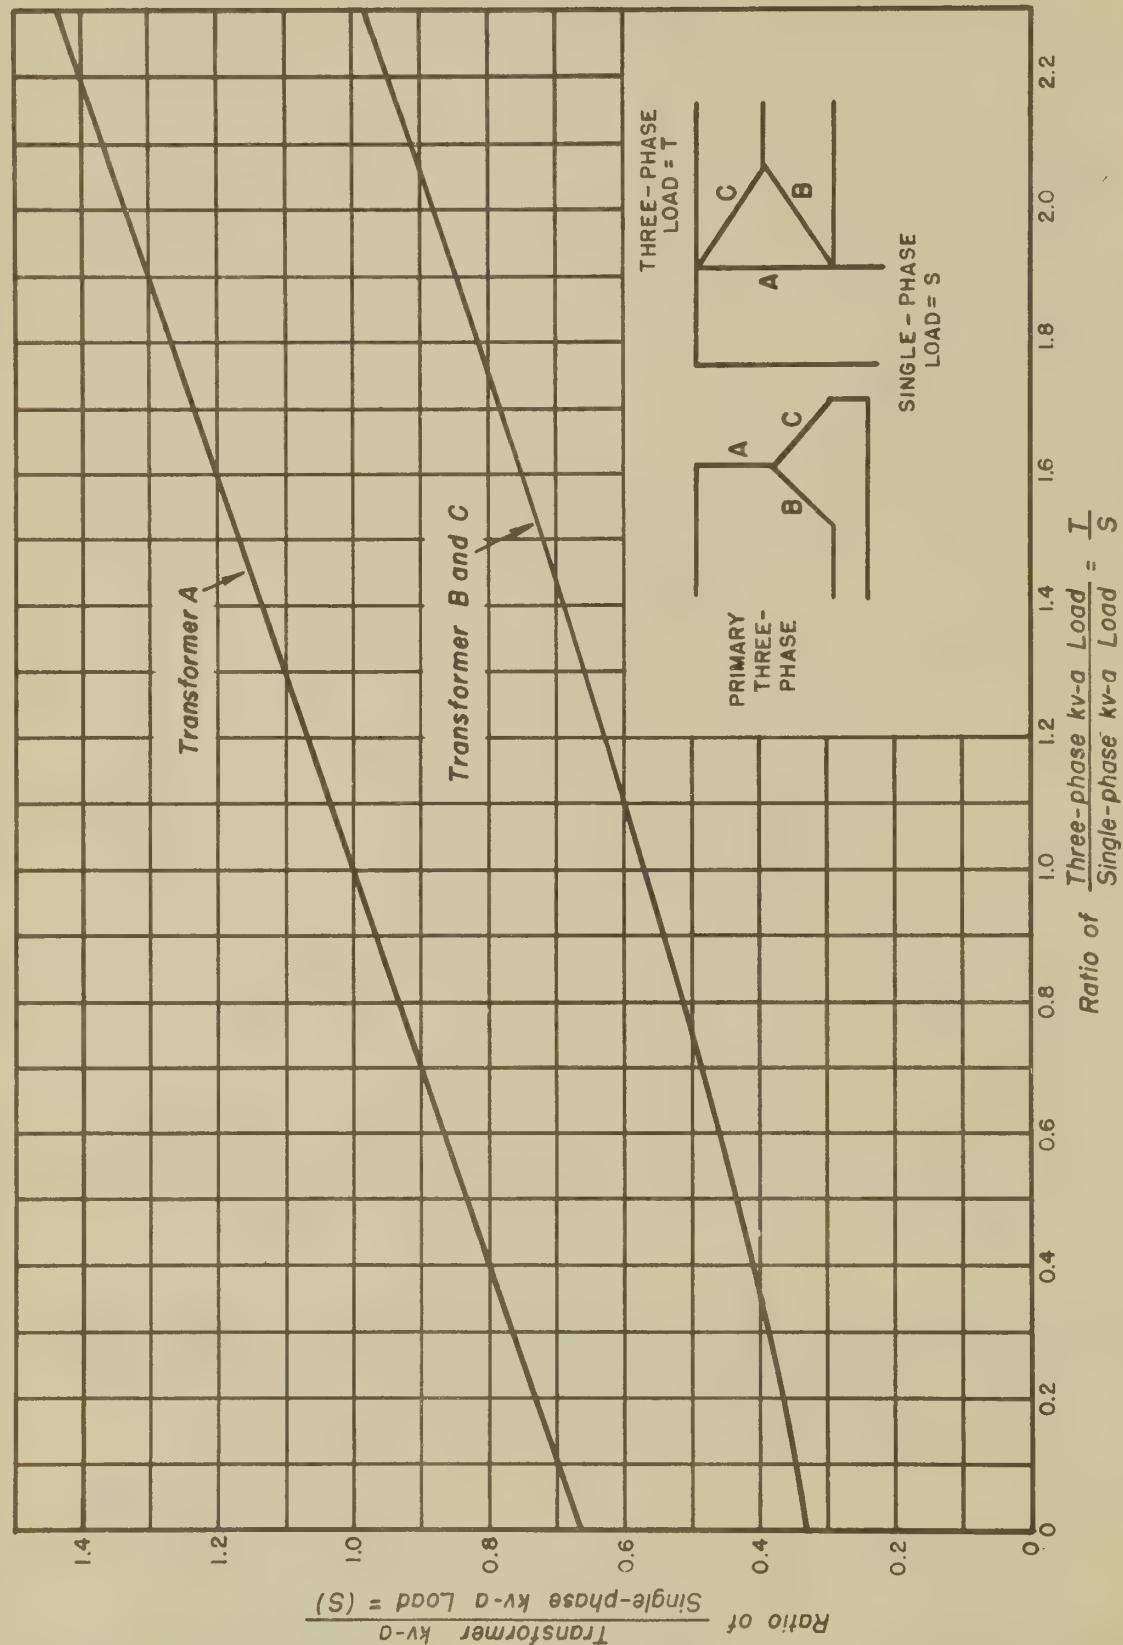
Transformer Capacity for Combined Single-phase and Three-phase
Loads on Isolated Y-Δ Bank, with the Same Power Factor
for Three-phase and Single-phase Loads.   Fig. 10

Solution: Use Fig. 10.

Ratio of three phase load to single phase load = $\frac{T}{S}$ = 2.0.
In Fig. 10 on the abscissa find 2.0 and proceed vertically
upward to the two curves. Proceeding horizontally from
the transformer B and C curve, we find that the ratio of
transformer KVA to single phase load KVA equals 0.87, and simi-
larly from the transformer A curve, we find that the ratio
of transformer KVA to single phase load KVA equals 1.33.
Hence, transformers B and C should be rated at least 0.87
(10) = 8.7 KVA and transformer A should be rated at least
1.33 (10) = 13.3 KVA. The next larger standard ratings would
be used, unless advantage were to be taken of the trans-
former overload capabilities.

VI. OVERLOADING OF TRANSFORMERS

A transformer may be overloaded during peak load conditions, pro-
viding light load follows and allows the transformer to cool off.
According to the Interim Report on overloading transformers by
the AIEE committee on electrical machinery (3): "For Daily Load
Factors below 100 Percent, the loading may be increased 0.3 per-
cent for each percent that the daily load factor is below 100
percent, with normal life expectancy in no case should the over-
load permitted by this factor exceed 15 percent." (3).

In accordance with the committee's recommendations, the following
table is suggested as a general guide for overloading transformers
on REA systems. (If load curves of the system are available, Tech-
nical Standards Bulletin No. 1 (6) may be used for greater accuracy
in estimating transformer overload capabilities.)

TABLE I

Permissible Transformer Overloads With No Reduction
In Life Expectancy. A. I. E. E. Recommendations

Daily Average Ambient Temperature		Percent Rated Load On Self-Cooled Transformers	
Degrees Centigrade	Degrees Fahrenheit	Daily Load Factor	
		50% or less	60%
-10	14	155	152
0	32	145	142
10	50	135	132
15	59	130	127
20	68	125	122
25	77	120	117
30	86	115	112
35	95	105	102
40	104	95	92
45	113	85	82

The load factor is, of course, the ratio of the average load over a period to the peak load occurring in that period. This means that the peak load can be, say 115 percent of the transformer rating when operating on a system whose load factor is 50 percent in a 30 degree C ambient temperature. Although the load period on REA systems is usually taken as one month for purposes of other work, it is necessary that a one-day period be used in determining the load factor for calculating allowable overloads on transformers.

Short time overloads with some reduction in life expectancy are also given in the AIEE Interim Report mentioned above.

Transformers may also be safely overloaded continuously if forced-air blowers, oil-coolers, or water sprays are added. Any such installation requires detailed investigation and should be referred to the transformer manufacturer.

VII. TRANSFORMER PROTECTION

A. Short Circuit Protection and Service Distance

Transformers are protected by fuses or circuit breakers on the primary, on the secondary, or both. Technical Standards Bulletin No. 4 (5) outlines the procedure for calculating the required ratings of such devices for adequate protection of the transformer against short circuits. The rating of the required device depends on the transformer size, the service size, length, and number of wires, and characteristics of the device to be used. In addition, the device must coordinate with other devices on the system. Table II shows the protection afforded by various standard makes of secondary fuses to various sizes of transformers for 120 volt and 120/240 volt services. Table II is based on 3.5% transformer impedance, which is conservative, and gives the maximum service distance for which various makes and sizes of fuses will protect transformers against short circuits. If a particular make and size of fuse protects a certain size of transformer for a short circuit at a specified distance of service, the fuse will, of course, also protect the transformer for short circuit at any lesser service distance. In addition, the table gives the various household devices which will coordinate with these secondary fuses for a minimum service length of 100 feet. The use of the table can best be explained by examples.

Note on Use of Table II:

The first column gives service distances. The second and alternate even columns give corresponding maximum secondary fuse size which will give protection to the transformer for a secondary fault at this distance.

The third and odd columns (starred) give the house device which will coordinate at a minimum service distance of 100 ft. with the corresponding secondary fuse. The household devices are listed

in order of slowness so that if a secondary fuse coordinates
with No. 5, it will also coordinate with Nos. 4, 3, 2 and 1, and
if it coordinates with No. 4, it will also coordinate with Nos. 3,
2, and 1, etc. In selecting the secondary fuse size, 30 ft.
should be added for the length of the service entrance cable.
In borderline cases, always select the smaller secondary fuse
rating.

Example 1:

Given a transformer installation of 3 KVA with three No. 6
(120/240 volt) service conductors, using a Schweitzer and Conrad
silver cartridge type SSI secondary fuse at the transformer, and
35 ampere "Quick Lag" breakers in the service entrance, what is
the greatest possible service length which may be used with full
protection afforded to the transformer against secondary short
circuits, and still coordinate the secondary fuse with the
service entrance breaker?

Solution:

Use the 3 KVA 3 wire transformer sheet. In the SSI column under
No. 6 service, it can be seen that a service length up to 2000
feet may be used with a 40 ampere SSI S&C fuse, a service length
up to 1400 feet may be used with a 50 ampere fuse, and a service
length up to 900 feet may be used with a 60 ampere fuse. Any of
these fuses will coordinate with the service entrance breaker
specified for any service length beyond 100 feet. Hence, a mini-
mum distance of 100 feet and a maximum distance of 900, 1400 or
2000 feet depending on the secondary fuse size may be used for
the service in this particular case.

Example 2:

Given, transformer installation of 5 KVA with a 3 wire, No. 4
service and a service distance up to 500 feet. The service
entrance protection is a 60 ampere fuse. What size General
Electric catalogue 9F13A secondary fuse will protect the transformers?

Solution:

Going to the 5 KVA 3 wire sheet, on the 500 foot row for No. 4
Service and under the GEI column, it can be seen that a 95 ampere
secondary fuse will do the job. However, since the 60 ampere
service entrance fuse will also coordinate with the 85 ampere
secondary fuse, the 85 ampere secondary fuse may be used for
more conservative protection if desired. It is usually pref-
erable to use the smallest secondary device which will still
coordinate with the service entrance protection.

Table II is based on characteristics furnished by the various manufacturers in 1942. The table is intended only as a guide, and special cases should be worked out by the system engineer.

Table III shows the maximum service distances which may be used with one type of transformer with internal and secondary breaker so as to obtain protection against secondary short circuits. Table III is based on ASA Permissible Emergency overload curves and transformer manufacturer's data on the secondary breaker characteristics.

The service distance may not only be limited by the transformer protective problem, but may also be limited by the voltage drop. Fig. 11 gives the voltage drops to be expected for various transformer sizes and services. The drop including the transformer and service should be added to the existing or anticipated primary drop to obtain the total drop at the load. This drop should be within the required limits in order to provide adequate service. The selected service distance should be the lesser of the two figures given by the fault current protective and voltage drop requirements.

Transformer primary fusing schedules may be calculated in the same manner as the secondary fusing tables. Unfortunately, experience has shown that for the smaller sizes of distribution transformers on 7200 volt lines, the primary fuse size required to provide protection against secondary faults is so small that it is frequently blown by lightning surges, or damaged by mechanical vibration. Hence, primary fuse ratings in use on REA systems have been increased since 1936. The present recommended primary transformer fuse ratings and the maximum service distances for which protection may be provided against secondary short circuits for transformer impedance of 3.5 percent are shown in Table IV. The large variation in fuses made by different manufacturers is readily apparent.

Although distribution transformers of less than 10 KVA will usually have an impedance of less than 3.5 percent, and the primary fuse will therefore provide greater protection than shown, it can be seen that, in the main, little protection against secondary troubles is furnished by such primary fuse ratings. Smaller ratings will offer more protection, but at the same time more false fuse blowings can be expected. Since the transformer failure rate has been small on REA systems, the trend has been toward the higher fuse ratings.

B. Lightning Protection

Transformers are protected by arresters, expulsion tubes or open gaps. The function of such devices is to limit the voltage drop between the transformer windings and between windings and ground to a value, as far as practicable below that at which the insulation will fail. In order to hold the transformer tank, the midpoint of the low voltage winding, and the ground sides of the

- 18 -

SECONDARY DROP AT RATED TRANSFORMER KVA 90 PERCENT POWER FACTOR BALANCED LOAD, CONCENTRATED AT END OF CIRCUIT

FOR DISTRIBUTED LOAD USE D1½ LENGTH OF SERVICE

FOR LOADS OTHER THAN TRANSFORMER RATING, DROP IS PROPORTIONAL TO LOAD

FOR TRANSFORMER IMPEDENCE OF 3.5 PERCENT. FOR OTHER IMPEDENCE Z ADD (Z-3.5) TO PERCENT DROP FOR APPROXIMATE RESULTS

PERCENT VOLTAGE DROP

VOLTS DROP ON 120 VOLT 2 WIRE OR ON EACH SIDE OF 120/240 VOLT 3 WIRE SERVICE

1 1/2 KVA 8 2 WIRE
7 1/2 KVA 8 3 WIRE
1 KVA 8 2 WIRE
1 KVA 6 2 WIRE
5 KVA 6 3 WIRE
7 1/2 KVA 4 3 WIRE
1 1/2 KVA 6 2 WIRE
7 1/2 KVA 6 2 WIRE
5 KVA 4 3 WIRE
3 KVA 6 3 WIRE
1 1/2 KVA 8 3 WIRE
5 KVA 2 3 WIRE
3 KVA 4 3 WIRE
1 1/2 KVA 6 3 WIRE
1 1/2 KVA 4 3 WIRE

D—DISTANCE OF SERVICE IN FEET

DEPARTMENT OF AGRICULTURE
RURAL ELECTRIFICATION ADMINISTRATION
SEPTEMBER 18, 1942

Fig. 11
-19-

Service Dist.	M1 *	M2 *	GE1 *	GE2 *	LM *	SS1 *	SS2 *	K *	SC1 *	SC2 *	SC3 *	B *
Number 8 Service												
100												
125												
150	60 3	75 3	75 4	75 4	50 4	40 4	100 4	60 4	50 4	50 4	40 4	25 4
175	60 3	50 3	50 3	75 4	50 4	40 4	100 4	60 4	50 4	50 4	40 4	25 4
200	60 3	50 3	50 3	75 4	50 4	40 4	100 4	60 4	50 4	50 4	40 4	25 3
300	60 3	50 3	50 3	50 3	50 4	40 4	75 4	60 4	50 4	50 4	40 4	20 3
400	50 3	50 3	50 3	50 3	40 3	40 4	75 4	50 4	50 4	40 4	30 4	20 3
500	50 3	50 3	45 3	45 3	40 3	40 4	75 4	50 4	40 4	30 3	30 4	20 3
600	50 3	45 1	45 3	45 3	40 3	40 4	60 3	40 3	30 3	30 3	25 3	15 3
700	40 1	45 1	45 3	45 3	40 3	40 4	60 3	40 3	30 3	30 3	25 3	15 3
800	40 1	40 1	40 3	40 3	30 2	30 4	60 3	40 3	30 3	20 3	25 3	15 3
900	40 1	40 1	40 3	40 3	30 2	30 4	60 3	40 3	30 3	20 3	25 3	15 3
1000	40 1	40 1	40 3	40 3	30 2	30 4	50 3	30 3	30 3	20 3	25 3	15 3
1200	40 1	30	40 3	30 1	30 2	30 4	40 3	30 3	25 3	20 3	20 3	15 3
1400	30 1	30	30 1	30 1	25 1	30 4	40 3	30 3	25 3	20 3	15 2	15 3
1600	25	25	25 1	25 1	25 1	30 4	40 3	25 3	20 3	20 3	15 2	15 3
1800	25	25	25 1	25 1	25 1	30 4	30 2	25 3	15 1	20 3	15 2	15 3
2000	20	25	20 1	25 1	25 1	25 4	30 2	20 1	15 1	15 1	15 2	15 3
Number 6 Service												
100												
125												
150	75 4	75 3	75 4	75 4	50 4	50 4	100 4	60 4	60 4	50 4	40 4	25 4
175	75 4	75 3	75 4	75 4	50 4	50 4	100 4	60 4	60 4	50 4	40 4	25 4
200	75 4	75 3	75 4	75 4	50 4	50 4	100 4	60 4	60 4	50 4	40 4	25 4
300	60 3	75 3	75 4	75 4	50 4	40 4	100 4	60 4	60 4	50 4	40 4	25 4
400	60 3	50 3	50 3	50 3	50 4	40 4	100 4	60 4	50 4	50 4	40 4	25 4
500	50 3	50 3	50 3	50 3	50 4	40 4	75 4	50 4	50 4	50 4	30 4	20 3
600	50 3	50 3	50 3	50 3	40 3	40 4	75 4	50 4	50 4	40 4	30 4	20 3
700	50 3	50 3	45 3	45 3	40 3	40 4	75 4	50 4	40 4	40 4	30 4	20 3
800	50 3	50 3	45 3	45 3	40 3	40 4	75 4	50 4	40 4	30 3	30 4	20 3
900	50 3	45 1	45 3	45 3	40 3	40 4	75 4	40 3	40 4	30 3	25 3	15 3
1000	40 1	45 1	45 3	45 3	40 3	40 4	60 3	40 3	30 3	30 3	25 3	15 3
1200	40 1	40 1	40 3	40 3	30 2	30 4	60 3	40 3	30 3	20 3	25 3	15 3
1400	40 1	40 1	40 3	40 3	30 2	30 4	60 3	30 3	30 3	20 3	25 3	15 3
1600	40 1	40 1	30 1	40 3	30 2	30 4	50 3	30 3	25 3	20 3	25 3	15 3
1800	40 1	30	30 1	30 1	30 2	30 4	40 3	25 3	25 3	20 3	20 3	15 3
2000	30 1	30	30 1	30 1	25 1	30 4	40 3	25 3	20 3	20 3	15 2	15 3

Legend:

M1 - Matthews Cartridge Type C.T.S.
M2 - Matthews Fuse Link Series 50H and 100H below 100 amps. Series 100B above 100 amps.
GE1- Gen. Elec. Cartridge Catalog 9F13A
GE2- Gen. Elec. Fuse Links Type 9F1S
LM - Line Material Unifit (Cartridge and Link)
SS1- Southern States Cartridge Type S.F.L.
SS2- Southern States Cartridge Type S.X.L.
K - Kearney "Tubular" Cartridge
SC1- Schweitzer & Conrad Silver Cart. Type SSI
SC2-Schweitzer & Conrad Tin Cart. Type STI
SC3- Schweitzer & Conrad Tin Link Series 88,000
B - Bussman Type JLS Cartridge or JPX Link

*
1   15 Amp Fusetat
2   15 Amp Circuit Breaker (Quick-lag or Heineman magnetic)
3   30 Amp Fuse
4   25 Amp Multi-breaker

Table II Protection Afforded by Secondary Fuses of Various Makes Sheet 2
To 1½ KVA Transformer With 2 Wire 120 Volt Service

Service Dist.	M1*	M2*	GE1*	GE2*	LM*	SS1*	SS2*	K*	SC1*	SC2*	SC3*	B*
					Number 8 Service							
100												
125												
150	75 3	85 3	85 4	85 4	75 4	60 4	150 4	100 4	75 4	50 3	65 4	35 4
175	75 3	85 3	85 4	85 4	60 4	60 4	150 4	75 4	75 4	50 3	50 4	35 4
200	75 3	85 3	85 4	85 4	60 4	60 4	125 4	75 4	60 4	50 3	50 4	35 4
300	75 3	75 3	75 3	75 3	60 4	60 4	125 4	75 4	60 4	50 3	40 4	30 3
400	60 3	50 1	50 3	75 3	50 3	60 4	100 4	60 3	60 4	40 3	40 4	30 3
500	60 3	50 1	50 3	50 3	50 3	60 4	75 3	60 3	50 3	40 3	30 3	25 3
600	50 1	50 1	50 3	50 3	40 3	50 4	75 3	50 3	40 3	40 3	30 3	25 3
700	50 1	45 1	45 2	45 3	40 3	50 4	75 3	50 3	40 3	40 3	30 3	25 3
800	50 1	45 1	45 2	45 3	40 3	50 4	60 3	40 3	30 3	30 3	30 3	25 3
900	40 1	45 1	45 2	40 3	40 3	50 4	60 3	40 3	30 3	30 3	25 3	20 3
1000	40 1	40	40 2	40 3	30 1	40 4	60 3	40 3	30 3	30 3	25 3	20 3
1200	30	40	40 2	40 3	30 1	40 4	50 3	30 3	25 3	25 2	20 3	20 3
1400	30	30	30 1	30 1	30 1	40 4	40 3	30 3	25 3	25 3	20 3	20 3
1600	30	30	30 1	30 1	30 1	30 3	40 3	25 2	25 3	20 2	15 1	20 3
1800	25	25	25 1	30 1	25 1	30 3	30 1	25 2	25 3	20 2	15 1	15 1
2000	25	25	25 1	25	25 1	25 3	30 1	25 2	25 3	15 1	15 1	15 1
					Number 6 Service							
100												
125												
150	100 4	95 4	85 4	75 4	75 4	60 4	150 4	100 4	75 4	50 3	65 4	35 4
175	100 4	95 4	85 4	75 4	75 4	60 4	150 4	100 4	75 4	50 3	65 4	35 4
200	100 4	95 4	85 4	75 4	75 4	60 4	150 4	100 4	75 4	50 3	65 4	35 4
300	75 3	85 3	85 4	75 4	60 4	60 4	125 4	75 4	75 4	50 3	65 4	35 4
400	75 3	85 3	75 3	50 3	60 4	60 4	125 4	75 4	60 4	50 3	50 4	30 3
500	60 3	75 3	75 3	50 3	60 4	60 4	100 4	75 4	60 4	50 3	40 4	30 3
600	60 3	50 1	50 3	50 3	50 3	60 4	100 4	60 3	60 4	40 3	40 4	30 3
700	60 3	50 1	50 3	50 3	50 3	60 4	100 4	60 3	50 3	40 3	40 4	25 3
800	60 3	50 1	50 3	45 3	50 3	50 4	75 3	50 3	50 3	40 3	30 3	25 3
900	60 3	50 1	50 3	45 3	40 3	50 4	75 3	50 3	40 3	40 3	30 3	25 3
1000	50 1	45 1	45 2	45 3	40 3	50 4	75 3	40 3	40 3	30 3	30 3	25 3
1200	50 1	45 1	45 2	45 3	40 3	50 4	75 3	40 3	40 3	30 3	30 3	20 3
1400	40 1	45 1	40 2	40 3	40 3	50 4	60 3	40 3	30 3	30 3	30 3	20 3
1600	40 1	40	40 2	40 3	30 1	40 4	60 3	40 3	30 3	30 3	25 3	20 3
1800	30	30	30 1	30 1	30 1	40 4	50 3	30 3	25 3	25 3	20 3	20 3
2000	30	30	30 1	30 1	30 1	40 4	40 3	30 3	25 3	25 3	20 3	20 3

Legend:
M1-Matthews Cartridge Type C.T.S.
M2-Matthews Fuse Link Series 50 H and 100 H
   below 100 amps. Series 100B above 100 amps.
GE1-Gen. Elec. Cartridge Catalog 9F13A
GE2-Gen. Elec. Fuse Links Type 9F1S
LM-Line Material Unifit (Cartridge and link)
SS1-Southern States Cartridge Type S.F.L.
SS2-Southern States Cartridge Type S.X.L.
K-Kearney "Tubular" Cartridge
SC1-Schweitzer & Conrad Silver Cart. Type SS1
SC2-Schweitzer & Conrad Tin Cart. Type STI
SC3-Schweitzer & Conrad Tin Link Series 88,000
B-Bussman Type JLS Cartridge or JPX Link

*
1   20 Amp Fusetat
2   30 Amp Fuse
3   20 Amp Circuit Breaker
    (Quicklag or Heinemann
    magnetic)
4   35 Amp Multi-breaker

Table II Protection Afforded by Secondary Fuses of Various Makes To 1½ KVA Transformer With 3 Wire 120/240 Volt Service

Number 8 Service

Service Dist	M1*	M2*	GE1*	GE2*	LM*	SS1*	SS2*	K*	SC1*	SC2*	SC3*	B*
100												
125												
150	75 4	50 2	50 3	75 5	50 3	30 4	75 3	50 3	50 4	40 3	30 3	20 3
175	75 4	50 2	50 3	75 5	50 3	30 4	75 3	50 3	50 4	40 3	30 3	20 3
200	60 3	50 2	50 3	75 5	40 3	30 4	75 3	50 3	50 4	40 3	30 3	20 3
300	60 3	50 2	50 3	50 3	40 3	30 4	75 3	50 3	50 4	40 3	30 3	15 3
400	50 2	50 2	45 3	45 3	40 3	30 4	75 3	50 3	40 3	30 3	30 3	15 3
500	50 2	45 1	45 3	45 3	40 3	30 4	75 3	50 3	40 3	30 3	30 3	15 3
600	50 2	45 1	45 3	45 3	40 3	30 4	60 3	40 3	30 3	30 3	25 3	15 3
700	40 2	45 1	40 2	45 3	30 1	30 4	60 3	40 3	30 3	30 3	25 3	15 3
800	40 1	40	40 2	45 3	30 1	30 4	60 3	30 3	30 3	25 3	25 3	12 2
900	40 1	40	40 2	40 2	30 1	30 4	50 3	30 3	30 3	25 3	20 3	12 2
1000	30	40	30 1	40 2	30 1	30 4	50 3	30 3	25 3	25 3	20 3	12 2
1200	30	30	30 1	30 1	30 1	30 4	40 3	25 2	25 3	20 2	20 3	12 2
1400	25	25	25 1	30 1	25 1	25 3	40 3	25 2	20 2	20 2	15 2	12 2
1600	25	25	25 1	30 1	25 1	25 3	30 2	20 1	20 2	15 1	15 2	12 2
1800	25	25	25 1	25 1	20 1	25 3	30 2	20 1	15 1	15 1	15 2	12 2
2000	25	25	20	25 1	20 1	25 3	30 2	15 1	15 1	15 1	10 1	12 2

Number 6 Service

Service Dist	M1*	M2*	GE1*	GE2*	LM*	SS1*	SS2*	K*	SC1*	SC2*	SC3*	B*
100												
125												
150	75 4	50 2	50 3	75 5	50 3	40 5	75 3	60 4	60 5	40 3	40 5	20 3
175	75 4	50 2	50 3	75 5	50 3	40 5	75 3	60 4	60 5	40 3	40 5	20 3
200	75 4	50 2	50 3	75 5	50 3	40 5	75 3	60 4	50 4	40 3	40 5	20 3
300	60 3	50 2	50 3	75 5	40 3	30 4	75 3	50 3	50 4	40 3	30 3	20 3
400	60 3	50 2	50 3	50 3	40 3	30 4	75 3	50 3	50 4	40 3	30 3	20 3
500	60 3	50 2	50 3	50 3	40 3	30 4	75 3	50 3	50 4	40 3	30 3	15 3
600	60 3	50 2	50 3	50 3	40 3	30 4	75 3	50 3	40 3	40 3	30 3	15 3
700	50 2	45 1	45 3	50 3	40 3	30 4	75 3	50 3	40 3	30 3	30 3	15 3
800	50 2	45 1	45 3	45 3	40 3	30 4	75 3	40 3	40 3	30 3	25 3	15 3
900	50 2	45 1	45 3	45 3	40 3	30 4	75 3	40 3	40 3	30 3	25 3	15 3
1000	40 1	45 1	45 3	45 3	40 3	30 4	60 3	40 3	30 3	30 3	25 3	15 3
1200	40 1	40	40 2	45 3	40 3	30 4	60 3	40 3	30 3	25 3	25 3	12 2
1400	40 1	40	40 2	40 2	40 3	30 4	50 3	30 3	30 3	25 3	20 3	12 2
1600	30	40	30 1	40 2	30 1	30 4	50 3	30 3	25 3	25 3	20 3	12 2
1800	30	30	30 1	30 1	30 1	30 4	50 3	25 2	25 3	20 2	20 3	12 2
2000	30	30	30 1	30 1	25 1	25 3	40 3	25 2	20 2	20 2	15 2	12 2

Legend: *

M1-Matthews Cartridge Type C.T.S.   1   20 Amp. Fusetat

M2-Matthews Fuse Link Series 50H and 100H   2   30 Amp Fuse

    below 100 amps. Series 100B above 100 amps.   3   20 Amp Circuit Breaker

GE1-Gen. Elect. Cartridge Catalog 9F13A   (Quicklag or Heinemann

GE2-Gen. Elec. Fuse Links Type 9F1S   magnetic)

LM-Line Material Unifit (Cartridge and Link)   4   60 Amp Fuse

SS1-Southern States Cartridge Type S.F.L.   5   35 Amp Multi-breaker

SS2-Southern States Cartridge Type S.X.L.

K-Kearney "Tubular" Cartridge

SC1-Schweitzer & Conrad Silver Cart. Type SSI

SC2-Schweitzer & Conrad Tin Cart. Type STI

SC3-Schweitzer & Conrad Tin Link Series 88,000

B-Bussman Type JLS Cartridge or JPX Link

Service Dist.	M1*	M2*	GE1*	GE2*	LM*	SS1*	SS2*	K*	SC1*	SC2*	SC3*	B*
Number 6 Service												
100												
125												
150	100 4	100 4	95 5	95 5	75 4	60 5	**150 5**	100 5	100 5	75 5	65 5	40 4
175	100 4	100 4	85 4	95 5	75 4	60 5	150 5	100 5	100 5	75 5	65 5	40 4
200	100 4	100 4	85 4	95 5	75 4	60 5	150 5	100 5	100 5	75 5	65 5	40 4
300	100 4	95 4	85 4	95 5	75 4	60 5	150 5	100 5	75 4	75 5	65 5	35 4
400	75 3	85 4	85 4	85 5	75 4	60 5	150 5	75 4	75 4	60 4	50 4	35 4
500	75 3	85 4	73 3	75 4	60 4	60 5	125 4	75 4	75 4	60 4	50 4	30 3
600	75 3	75 2	73 3	75 4	60 4	60 5	125 4	75 4	60 4	60 4	40 4	30 3
700	60 2	50	73 3	75 4	50 3	60 5	100 4	60 4	60 4	50 4	40 4	30 3
800	60 2	50	50 2	75 4	50 3	60 5	100 4	60 4	60 4	50 4	40 4	25 2
900	60 2	50	50 2	75 4	50 3	60 5	75 4	60 4	50 4	50 4	30 3	25 2
1000	50 2	50	50 2	50 2	40 2	50 4	75 4	50 3	40 4	40 3	30 3	25 2
1200	50 2	45	45 2	50 2	40 2	50 4	75 4	50 3	30 3	30 2	30 3	25 2
1400	50 2	45	45 2	45 2	40 2	50 4	60 2	40 2	30 3	30 2	25 2	20 1
1600	40	45	40 2	40 2	30 2	40 4	60 2	40 2	30 3	30 2	25 2	20 1
1800	40	40	40 2	40 2	30 2	40 4	60 2	40 2	30 3	30 2	25 2	20 1
2000	40	40	30	40 2	30 2	40 4	50 2	30 2	20 2	20 2	25 2	20 1
Number 4 Service												
100												
125												
150	100 4	100 4	95 5	100 5	75 4	75 5	150 5	100 5	100 5	75 5	80 5	40 4
175	100 4	100 4	95 5	100 5	75 4	75 5	150 5	100 5	100 5	75 5	80 5	40 4
200	100 4	100 4	95 5	100 5	75 4	75 5	150 5	100 5	100 5	75 5	65 5	40 4
300	100 4	100 4	95 5	95 5	75 4	60 5	150 5	100 5	75 4	75 5	65 5	40 4
400	100 4	95 4	85 4	95 5	75 4	60 5	150 5	100 5	75 4	75 5	65 5	35 4
500	100 4	95 4	85 4	85 5	75 4	60 5	150 5	75 4	75 4	60 4	65 5	35 4
600	75 3	85 4	85 4	85 5	75 4	60 5	150 5	75 4	75 4	60 4	50 4	35 4
700	75 3	85 4	85 4	85 5	60 4	60 5	125 4	75 4	75 4	60 4	50 4	35 4
800	75 3	85 4	73 3	75 4	60 4	60 5	125 4	75 4	75 4	60 4	50 4	30 3
900	75 3	75 2	73 3	75 4	60 4	60 5	125 4	75 4	75 4	60 4	50 4	30 3
1000	60 2	75 2	73 3	75 4	50 3	60 5	100 4	60 4	60 4	50 4	40 4	30 3
1200	60 2	50	50 2	75 4	50 3	60 5	100 4	60 4	60 4	50 4	40 4	25 2
1400	60 2	50	50 2	75 4	50 3	50 5	75 4	60 4	50 4	50 4	40 4	25 2
1600	50 2	50	50 2	50 2	40 2	50 5	75 4	50 3	40 3	40 3	30 3	25 2
1800	50 2	45	45 2	50 2	40 2	50 5	75 4	50 3	40 3	40 3	30 3	25 2
2000	50 2	45	45 2	45 2	40 2	50 5	75 4	50 3	40 3	30 2	30 3	25 2

Legend:
M1-Matthews Cartridge Type C.T.S.
M2-Matthews Fuse Link Series 50H and 100H
   below 100 amps. Series 100B above 100 amps.
GE1-Gen. Elec. Cartridge Catalog 9F13A
GE2-Gen. Elec. Fuse Links Type 9F1S
LM-Line Material Unifit (Cartridge and Link)
SS1-Southern States Cartridge Type S.F.L.
SS2-Southern States Cartridge Type S.X.L.
K-Kearney "Tubular" cartridge
SC1-Schweitzer & Conrad Silver Cart. Type SSI
SC2-Schweitzer & Conrad Tin Cart. Type STI
SC3-Schweitzer & Conrad Tin Link Series 88,000
B-Bussman Type JLS Cartridge or JPX Link

*
1   30 Amp Fusetat
2   30 Amp Fuse
3   35 Amp Circuit Breaker (Quick
     lag or Heinemann magnetic)
4   60 Amp Fuse
5   50 Multi-breaker

Table II Protection Afforded by Secondary Fuses of Various Makes To 5 KVA Transformer With 3 Wire 120/240 Volt Service Sheet 5

Service Dist	M1*	M2*	GE1*	GE2*	LM*	SS1*	SS2*	K*	SC1*	SC2*	SC3*	B*
					Number 6 Service							
100												
125												
150	150 4	125 2	125 4	100 4	100 4	100 4	150 4	150 4	150 4	125 4	100 4	60 4
175	150 4	125 2	100 4	100 4	100 4	100 4	150 4	150 4	125 4	125 4	100 4	60 4
200	150 4	125 2	100 4	100 4	100 4	100 4	150 4	150 4	125 4	125 4	100 4	60 4
300	125 3	100 2	100 4	100 4	85 4	100 4	150 4	125 4	100 4	100 4	80 4	50 3
400	100 2	95 1	95 3	95 4	85 4	100 4	150 4	100 4	100 4	75 3	65 4	50 3
500	100 2	95 1	85 2	85 3	75 3	75 4	150 4	100 4	75 4	75 3	65 4	50 3
600	75 1	85	85 2	85 3	75 3	75 4	150 4	75 3	75 4	75 3	65 4	40 3
700	75 1	75	75 2	75 2	60 2	75 4	125 3	75 3	75 4	60 2	50 3	40 3
800	60	50	75 2	75 2	60 2	75 4	100 2	75 3	60 3	60 2	50 3	40 3
900	60	50	75 2	75 2	50 1	75 4	100 2	60 2	60 3	60 2	40 2	40 3
1000	60	50	50	50 1	50 1	75 4	100 2	60 2	50 2	50 2	40 2	40 3
1200	50	45	50	50 1	50 1	75 4	75 2	60 2	40 2	50 2	40 2	35 2
1400	50	45	45	45	40	60 4	75 2	50 1	40 1	40 1	30 2	35 2
1600	50	45	45	45	40	60 4	60 1	50 1	30	30 1	30 2	35 2
1800	50	40	40	40	40	60 4	60 1	40	30	30 1	30 2	30 1
2000	50	40	40	40	40	50 4	50	40	30	30	30 2	30 1
					Number 4 Service							
100												
125												
150	200 4	125 2	125 4	100 4	100 4	125 4	150 4	150 4	150 4	125 4	100 4	60 4
175	150 4	125 2	125 4	100 4	100 4	100 4	150 4	150 4	150 4	125 4	100 4	60 4
200	150 4	125 2	125 4	100 4	100 4	100 4	150 4	150 4	150 4	125 4	100 4	60 4
300	150 4	125 2	100 4	100 4	100 4	100 4	150 4	150 4	125 4	125 4	100 4	60 4
400	125 3	100 2	100 4	100 4	85 4	100 4	150 4	125 4	125 4	100 4	80 4	50 3
500	125 3	100 2	95 3	95 4	85 4	100 4	150 4	100 4	100 4	100 4	80 4	50 3
600	100 2	95 1	95 3	95 4	85 4	100 4	150 4	100 4	100 4	75 3	65 4	50 3
700	100 2	95 1	85 2	95 4	85 4	100 4	150 4	100 4	75 4	75 3	65 4	50 3
800	100 2	95 1	85 2	85 3	75 3	75 4	150 4	100 4	75 4	75 3	65 4	50 3
900	75 1	85	85 2	85 3	75 3	75 4	150 4	75 3	75 4	75 3	65 4	40 3
1000	75 1	85	85 2	85 3	60 2	75 4	125 3	75 3	75 4	60 2	50 3	40 3
1200	75 1	75	75 2	75 2	60 2	75 4	125 3	75 3	60 3	60 2	50 3	40 3
1400	60	50	75 2	75 1	60 2	75 4	100 2	60 2	60 3	60 2	50 3	40 3
1600	60	45	50	50 1	50 1	75 4	100 2	60 2	50 2	60 2	40 2	40 3
1800	60	45	50	50 1	50 1	75 4	75 2	60 2	50 2	60 2	40 2	35 2
2000	50	45	50	45	40	60 4	75 2	50 1	40 1	60 2	30 2	35 2

Legend:

M1-Matthews Cartridge Type C.T.S.
M2-Matthews Fuse Link Series 50H and 100H
   below 100 amps.   Series 100B above 100 amps.
GE1-Gen. Elec. Cartridge Catalog 9F13A
GE2-Gen. Elec. Fuse Links Type 9F1S
LM-Line Material Unifit (Cartridge and Link)
SS1-Southern States Cartridge Type S.F.L.
SS2-Southern States Cartridge Type S.X.L.
K-Kearney "Tubular" Cartridge
SC1-Schweitzer & Conrad Silver Cart. Type SS1
SC2-Schweitzer & Conrad Tin Cart. Type STI
SC3-Schweitzer & Conrad Tin Link Series 88,000
B-Bussman Type JLS Cartridge or JPX Link

*
1 35 Amp Circuit Breaker (Quick lag or Heinemann magnetic)
2 60 Amp Fuse
3 35 Amp Fusetron
4 50 Amp Multi-Breaker

Table II Protection Afforded by Secondary Fuses of Various Makes To 7½ KVA Transformer With 3 Wire 120/240 Volt Service   Sheet 6

Service Dist.	M1*	M2*	GE1*	GE2*	LM*	SS1*	SS2*	K*	SC1*	SC2*	SC3*	B*
					Number 6 Service							
100												
125												
150	200 4	125 4	125 4	100 4	100 4	150 4	150 4	175 4	150 4	150 4	100 3	100 4
175	150 4	125 4	125 4	100 4	100 4	150 4	150 4	175 4	150 4	150 4	100 3	75 4
200	150 4	125 4	125 4	100 4	100 4	150 4	150 4	175 4	150 4	150 4	100 3	75 4
300	150 4	100 3	100 4	100 4	100 4	150 4	150 4	150 4	150 4	125 4	80 3	60 4
400	125 3	100 3	100 4	100 4	85 4	125 4	150 4	125 4	100 4	100 4	80 3	60 4
500	100 3	95 2	95 3	95 4	85 4	125 4	150 4	100 4	100 4	75 3	80 3	50 3
600	75 1	95 2	85 2	85 3	75 3	125 4	150 4	100 4	75 4	75 3	65 3	50 3
700	75 1	85 1	85 2	85 3	75 3	100 4	150 4	75 3	75 4	75 3	65 3	50 3
800	75 1	85 1	85 2	75 2	75 3	100 4	125 4	75 3	75 4	60 3	75 3	50 3
900	75 1	75	75 2	75 2	60 3	100 4	125 4	75 3	60 3	60 3	50 3	50 3
1000	60	75	75 2	75 2	60 3	100 4	100 3	75 3	60 3	60 3	50 3	50 3
1200	50	50	50	50 1	60 3	75 4	75 2	60 2	50 3	50 2	40 3	50 3
1400	50	50	50	50 1	50 1	50 4	75 2	60 2	40 1	50 2	40 3	40 3
1600	50	45	50	40	50 1	50 4	75 2	50 1	30	50 2	40 3	40 3
1800	40	45	40	40	50 1	50 4	60 1	50 1	30	30	30 2	35 2
2000	40	40	40	40	50 1	50 4	50	40	30	30	30 2	35 2
					Number 4 Service							
100												
125												
150	200 4	125 4	150 4	100 4	150 4	150 4	150 4	200 4	200 4	200 4	100 4	100 4
175	200 4	125 4	150 4	100 4	150 4	150 4	150 4	200 4	200 4	200 4	100 4	100 4
200	200 4	125 4	125 4	100 4	150 4	150 4	150 4	175 4	200 4	150 4	100 4	100 4
300	150 4	125 4	125 4	100 4	100 4	150 4	150 4	175 4	150 4	150 4	100 4	75 4
400	150 4	125 4	100 4	100 4	100 4	150 4	150 4	150 4	150 4	125 4	100 4	75 4
500	125 3	100 3	100 4	100 4	100 4	125 4	150 4	125 4	125 4	125 4	80 4	60 4
600	125 3	100 3	100 4	100 4	85 4	125 4	150 4	125 4	100 4	100 4	80 4	60 4
700	100 3	100 3	95 3	95 4	85 4	125 4	150 4	100 4	100 4	100 4	80 4	60 4
800	100 3	95 2	95 3	95 4	85 4	125 4	150 4	100 4	100 4	75 3	65 4	50 3
900	100 3	95 2	85 2	85 3	75 3	125 4	150 4	100 4	100 4	75 3	65 4	50 3
1000	75 1	85 1	85 2	85 3	75 3	100 4	150 4	100 4	75 4	75 3	65 4	50 3
1200	75 1	85 1	85 2	85 3	75 3	100 4	125 4	75 3	75 4	60 3	65 4	50 3
1400	75 1	75	75 2	75 2	60 3	100 4	125 4	75 3	60 3	60 3	50 3	50 3
1600	60	75	75 2	75 2	60 3	100 4	100 3	75 3	60 3	60 3	50 3	50 3
1800	60	50	50	75 2	60 3	75 4	100 3	60 2	60 3	50 2	40 3	50 3
2000	60	50	50	50 1	50 1	75 4	75 2	60 2	40 1	50 2	40 3	40 3

Legend:
M1-Matthews Cartridge Type C.T.S.
M2-Matthews Fuse Link Series 50H and 100H
   below 100 amps. Series 100B above 100 amps
GE1-Gen. Elec. Cartridge Catalog 9F13A
GE2-Gen. Elec. Fuse Links Type 9F1S
LM-Line Material Unifit (Cartridge and Link)
SS1-Southern States Cartridge Type S.F.L.
SS2-Southern States Cartridge Type S.X.L.
K-Kearney "Tubular" Cartridge
SC1-Schweitzer & Conrad Silver Cart. Type SSI
SC2-Schweitzer & Conrad Tin Cart. Type STI
SC3-Schweitzer & Conrad Tin Link Series 88,000
B-Bussman Type JLS Cartridge or JPX Link

*
1 35 Amp Circuit Breaker (Quick
   lag or Heineman magnetic)
2 60 Amp Fuse
3 35 Amp Fuseton
4 50 Amp Multi-breaker

Table III Protection Afforded by Internal Secondary Breaker on
One Type of Transformer so Equipped (Based on A.S.A.
Permissible Emergency Overload and Manufacturer's
Curves on the Internal Breaker)

Transformer Size and Type of Connection	Maximum Service Distance			Will Coordinate with Following at Minimum Service Distance of 100 Feet (1)
	#8	#6	#4	
1½ KVA 2 wire	860	1340		20 Amp Fusestat, 30 amp Fuse, 20 Amp Breaker (2)
1½ KVA 3 wire	1870	over 2000		20 Amp Fusestat, 30 amp Fuse
3 KVA 3 wire		1250	2000	30 Amp Fusestat, 30 amp Fuse 35 Amp Breaker (2), 60 amp Fuse
5 KVA 3 wire		670	1040	35 Amp Circuit Breaker (2) 60 amp Fuse 35 Amp Fusetron, 50 Amp multi-breaker
7½ KVA 3 wire		670	1130	35 Amp Circuit Breaker (2), 60 amp Fuse 35 Amp Fusetron, 50 amp Multi-breaker

(1) Will not coordinate with other device if such device has greater time
delay than those indicated.

(2) The circuit breaker is a Westinghouse " Quick Lag" or a Heinemann magnetic
or equivalent.

Table IV

Maximum Service Distance in Feet for Which Transformer
May be Protected Against Secondary Short Circuits.
Transformer Impedance = 3.5%

7200 Volt Transformer Rating, KVA	1½ (2 wire)		1½(3 wire)		3(3 wire)		5 (3 wire)		7½(3 wire)		10(3 wire)
REA Recommended primary fuse rating, amperes	2		2		2		3		5		5
Conductor Size	#8	#6	#8	#6	#6	#4	#6	#4	#6	#4	#4
Fuse Make											
1. General Electric Type 9F1C	60	150	0	0	280	430	160	250	130	200	270
2. Schweitzer & Conrad 64,000 Series	0	0	0	0	60	95	150	230	70	110	210
3. Matthews 100H	0	0	0	0	200	320	170	270	130	210	260
4. Kearney Type QA	180	280	70	120	420	640	360	550	140	220	280
5. Kearney Type 200	0	0	0	0	40	60	60	90	0	0	90
6. Westinghouse Type U T	0	0	0	0	0	0	0	0	0	0	20
7. Line Material Unifit	0	0	0	0	0	0	60	90	90	140	210
8. Southern States Type F or AF	0		0	0	0	0	0	0	0	0	210
9. Railway & Industrial Eng. Type P. T.	70	170	20	30	290	450	210	320	90	140	190

arrester and primary winding at the same voltage level, these points are interconnected together on multi-grounded REA systems (except in California) and also connected to the lightning arrester ground and the system neutral. The surge voltage stress on the transformer insulation is therefore practically independent of the ground resistance, and dependent only on the characteristics of the protective device and the lightning surge. The system manager should maintain such ground connections and the interconnections, since the life of the transformer will depend on them. An additional consideration is the adequate grounding of the case for safety reasons.

Although, as stated above, the resistance of the arrester ground has little effect on transformer protection if the interconnection scheme is used, this does not mean that the ground resistance is unimportant. If the resistance to ground of the arrester ground lead becomes high, the voltage on the tank will rise to a high level upon discharge of the arrester current through the ground resistance. Due to the interconnection of the secondary winding, this will in turn be impressed on the consumer's wiring. Such high voltages may be injurious. It is therefore very important that the individual lightning arrester ground and the service ground at the consumer's service entrance have as low resistance as possible. Considering the service entrance equipment and the consumer's premises, the ground at the consumer's premises is the most important, but it is the individual ground at the transformer nearest the consumer which is next in importance rather than the combined interconnected system neutral ground.

VIII Maintenance of Transformers

Transformers, like all other electrical equipment, must be maintained. (7) The amount of maintenance depends on the investment in the equipment and the importance of uninterrupted service. Substation transformers, in particular, should receive special attention. while transformers which serve important loads also require frequent inspection. Small distribution transformers, serving relatively unimportant loads, however, cannot receive a great deal of maintenance, due to the excessive costs which would be required by such a procedure. The usual practice with regard to such small transformers is to bring a transformer into the shop and provide a thorough check when a change in transformer installation is made.

The following concerns particularly maintenance of substation transformers, and, in lesser degree, and where practical, other transformers.

A. General Inspection

    1. Once a day, if possible, and at least once a week.

        a. Oil level. See if oil is up to required level.

b.   Ambient temperature. A record should be kept of ambient temperatures.

c.   Oil temperatures. A record of the oil temperature, particularly at peak demand, should be kept and coordinated with the ambient temperature. Some transformers have a load indicator instead of an oil temperature indicator in which case this reading should be made.

If it is impossible to take the temperature readings each day, the day of peak demand should be selected.

d.   Coil temperature. Some of the larger transformers have thermocouples embedded in the coils to indicate coil temperature. This temperature should be recorded periodically, particularly at peak load.

2.   Once a week, if possible, and at least once a month.

a.   Load current.

Check current in each phase by means of a clamp-on ammeter, or using an ammeter with current transformers, if such are installed, for load on transformers and phase balance of transformers and feeders. Make check during peak load period and on or near day of maximum demand.

b.   Voltage. Check voltage on each phase. It may be possible to eliminate over-excitation and excessive core loss by readjusting the tap connections. If a spare recording voltmeter is available, it is well to obtain a record of the voltage over a period of several days.

B.   Unit Inspection

1.   Quarterly

a.   Ground resistance. The ground resistance at an REA type substation is very important due to the multi-grounded line construction. The operation of the arresters and the safety of the station depend on the grounding resistance. The ground resistance will vary with location and season of the year, and no hard and fast rules applicable to all cases can be laid down. In general, the resistance should be under 5 ohms, if at all possible. Ground connections to arresters, transformer tanks, bushings, fence and grounding devices should be thoroughly checked.

b.   Oil tests. Manufacturer's instruction books and bulletins give methods for obtaining oil samples. Such instructions should be followed exactly, as many errors in oil tests are

due to improper sampling. It is particularly important that the container be clean and dry and that the oil be taken properly. The oil sample should be tested by the manufacturer or by a laboratory. Oil testing to high insulation value does not necessarily indicate satisfactory conditions, as water may appear in the open type transformers under certain conditions, and not show up in the oil tests. It is therefore necessary to make the under cover and core checks as described below.

   c. Lightning arresters and gaps. Check condition and settings of arresters and gaps.

   d. Breathers. See if breathers are open and operating properly.

2. Semi-annually

   a. Inspection under the cover. Inspection under the main cover, the manhole cover, and bushing supports should be made on an open type transformer to determine whether or not water condensation is taking place. During the initial period of operation, this should be done frequently, (approximately monthly) and after some operation, such inspection should be made at least semi-annually. If there is condensation, the manufacturer should be contacted for recommendations.

   The condition of any disturbed gaskets should be checked to see if a new gasket is needed before re-assembly. It is usually preferable to install a new gasket than to take a chance on an old one.

3. Biennially (every two years).

   a. Inspection above the core. On open type transformers, the oil should be drawn down to the top of the core, and all parts inspected for condensation and sludge about every two years.

   b. Oil filtering. The dielectric strength of the oil in an open type transformer must be maintained. If the oil test shows a dielectric strength of not more than 16 to 17 Kv for the one-tenth inch gap, the oil should be filtered. A dielectric strength above this is adequate, providing there is no local condensation. On oil conservator or gas seal transformers, oil filtering is rarely necessary.

c. Transformer and Refinishing. The transformer finish
should be inspected and any badly worn spots should be
repainted, or the entire tank should be refinished.
The most important step in such work is to thoroughly
prepare the surface by removing all loose paint,
blisters, scale, and rust; and in some cases all the
old paint should be removed. After cleaning, the tank
should be painted as soon as possible. Recommendations
on type of paint and primer, number of coats, etc.
should be obtained from the transformer manufacturer.

C. Detailed Inspection

An overall inspection should be made about every four or
five years. If deposits of sludge are found, the interior
of the transformer should be raised from the tank and
thoroughly washed with new oil. All parts should be
examined for displacement, tight connections, etc., and
the tank should be cleaned. If the sludging seems to be
excessive, the matter should be called to the attention
of the manufacturer. Most rural systems will necessarily
have to rotate the spare transformer so that one trans-
former can be inspected each year, until complete round
is made. If no spare is available, it might be possible
to use the open-delta or Vee connection described above
during periods of light load.

D. Unenergized Units

Where transformers hang on the line unenergized for long
periods, the underside of the cover and visible parts
should be checked for moisture, and oil samples should
be taken before energizing. If moisture is present,
recommendations should be obtained from the manufacturer
before energizing the transformers.

BIBLIOGRAPHY

1. Transformer Connections
     General Electric Bulletin - GET-2B

2. Transformer Engineering
     L. F. Blume (John Wiley & Sons, Inc.)

3. Interim Report on Guides for Overloading Transformers
     and Voltage Regulators
     A.I.E.E. Committee on Electrical Machinery - Transformer
     Subcommittee, 1942. Electrical Engineering, September
     1942, Volume 61.

4. Electrical Transmission and Distribution Reference Book
     Westinghouse Electric and Manufacturing Company

5. Procedure for Making a Sectionalizing Study on Rural
     Electric Systems - Technical Standards Bulletin No. 4
     U. S. Department of Agriculture
     Rural Electrification Administration

6. Determination of Permissible Overload on Distribution
     Transformers - Technical Standards Bulletin No. 1
     U. S. Department of Agriculture
     Rural Electrification Administration

7. Comments on Power Transformer Operation
     F. I. Manvell. General Electric Bulletin GET-549C

8. The J. and P. Transformer Book (Johnson & Phillips Ltd.)
     Stigant and Lacey.